


NOTE: WHERE LIGHT STANDARD IS NOT AVAILABLE FOR INSTALLATION PRIOR TO CONCRETE WALKWAY INSTALLATION, 1 SIDEWALK BAY SHALL BE LEFT OUT TO FACILITATE POLE INSTALLATION SIDEWALK SHALL BE POURED AROUND POLE BASE USING AN EXPANSION JOINT.

## DETAIL OF OPENING FOR LIGHT STANDARD

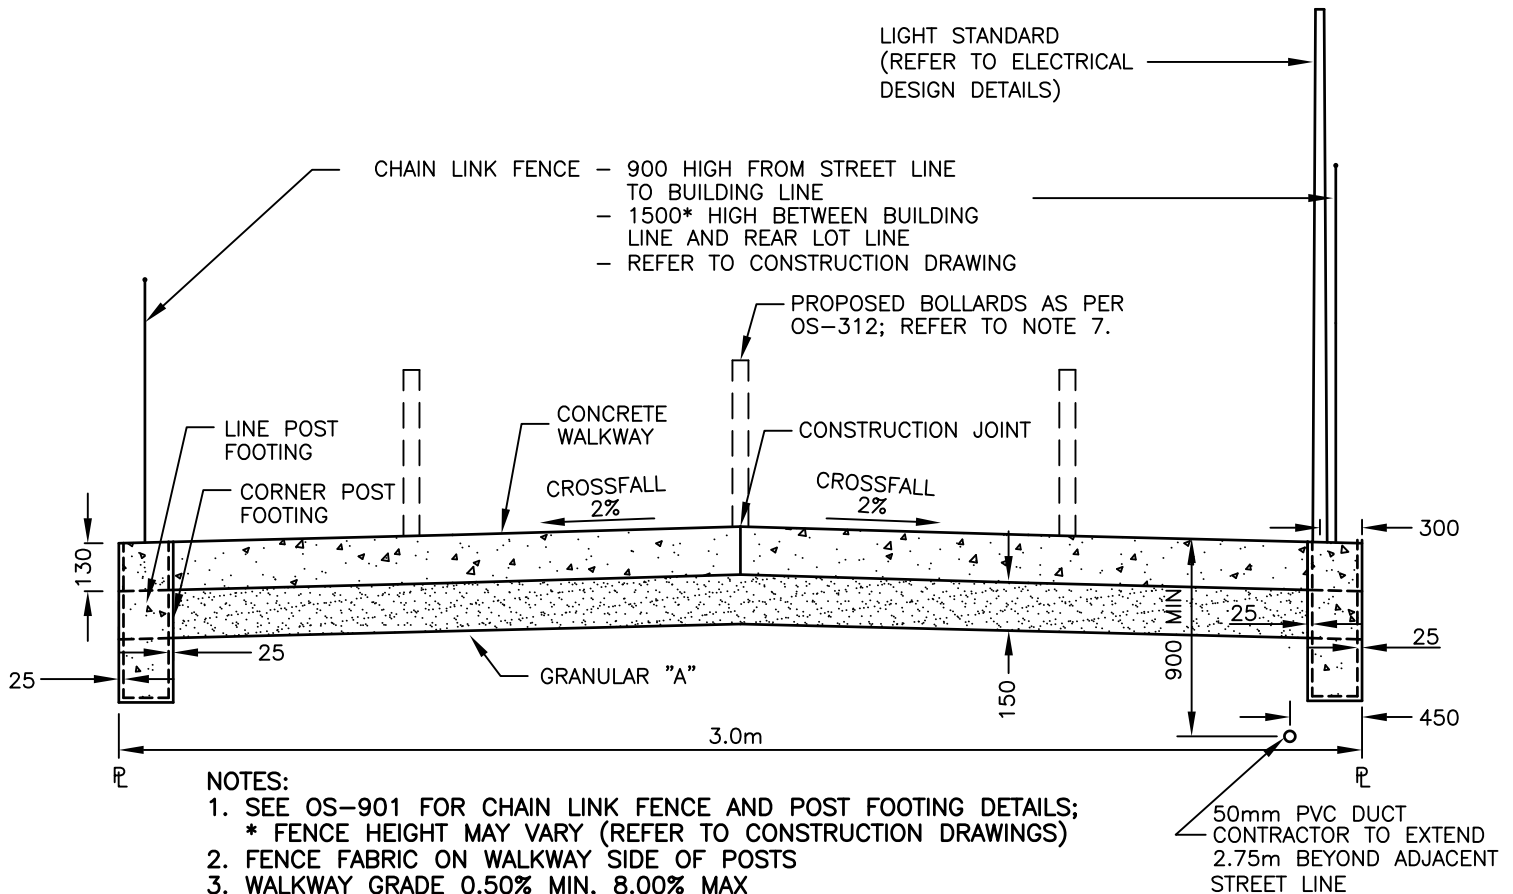

### NOTES:

1. SEE OS-901 FOR CHAIN LINK FENCE AND POST FOOTING DETAILS;  
\* FENCE HEIGHT MAY VARY (REFER TO CONSTRUCTION DRAWINGS)
2. FENCE FABRIC ON WALKWAY SIDE OF POSTS
3. WALKWAY GRADE 0.50% MIN, 8.00% MAX
4. COMPRESSIVE STRENGTH OF CONCRETE IS TO BE 32MPa AT 28 DAYS.
5. CONTROL JOINTS ARE TO BE PLACED UNIFORMLY AND CONSTRUCTED AS NOTED ON OS-301.
6. FOR TRANSITIONAL SUBGRADE END TREATMENT REFER TO OPSD-205.040.
7. BOLLARDS TO BE INSTALLED ONLY WHERE: i) EXTENDING WALKWAY TO ROAD WITH CURB DEPRESSION FOR RAMP; ii) CURB DEPRESSION FOR OVERLAND FLOW ROUTE.
8. MEASUREMENTS IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE SHOWN.

CITY OF OSHAWA

CHK'D: *S.S.*  
APP'D: *S.H.*  
DATE: JAN. 16, 2012

## 3.0m CONCRETE WALKWAY STREET TO STREET CONNECTION

REVISION No. 3  
DATE: JAN. 16, 2012  
OS-310