


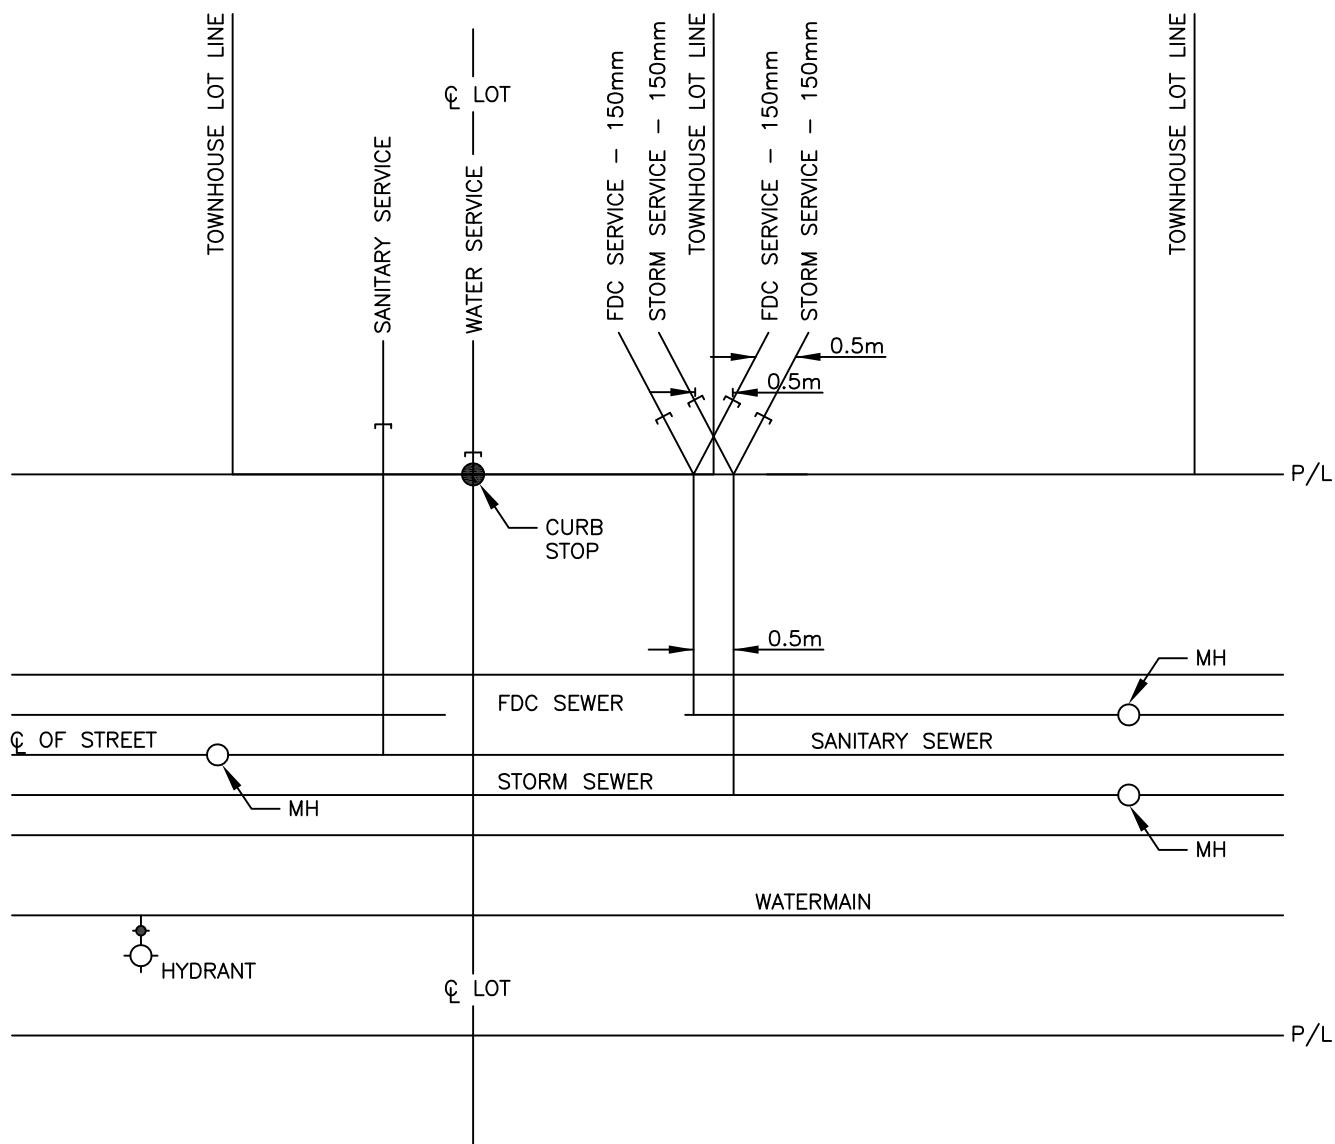

NOTE:

1. FOR WATER AND SANITARY SERVICE CONNECTION DETAILS, REFER TO REGION OF DURHAM STANDARD S-230.010.
2. STORM AND FDC SERVICES TO EXTEND 1.5m INSIDE PROPERTY LINE.
3. BEDDING DETAIL AS PER OS-401.
4. ROOF WATER LEADER CONNECTION TO STORM SHALL BE 150mm DIAMETER AT 2% MINIMUM GRADE.
5. 150mm STORM & FDC WYE CONNECTIONS TO BE USED.
6. MEASUREMENTS IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE SHOWN.

CITY OF OSHAWA

CHK'D:
S.S.
APP'D:
G.H.
DATE:
APRIL 27, 2021

SERVICE CONNECTION LOCATION TOWNHOUSE BLOCKS (NEW CONNECTIONS)

REVISION No.
DATE: APRIL 27, 2021
OS-1006