


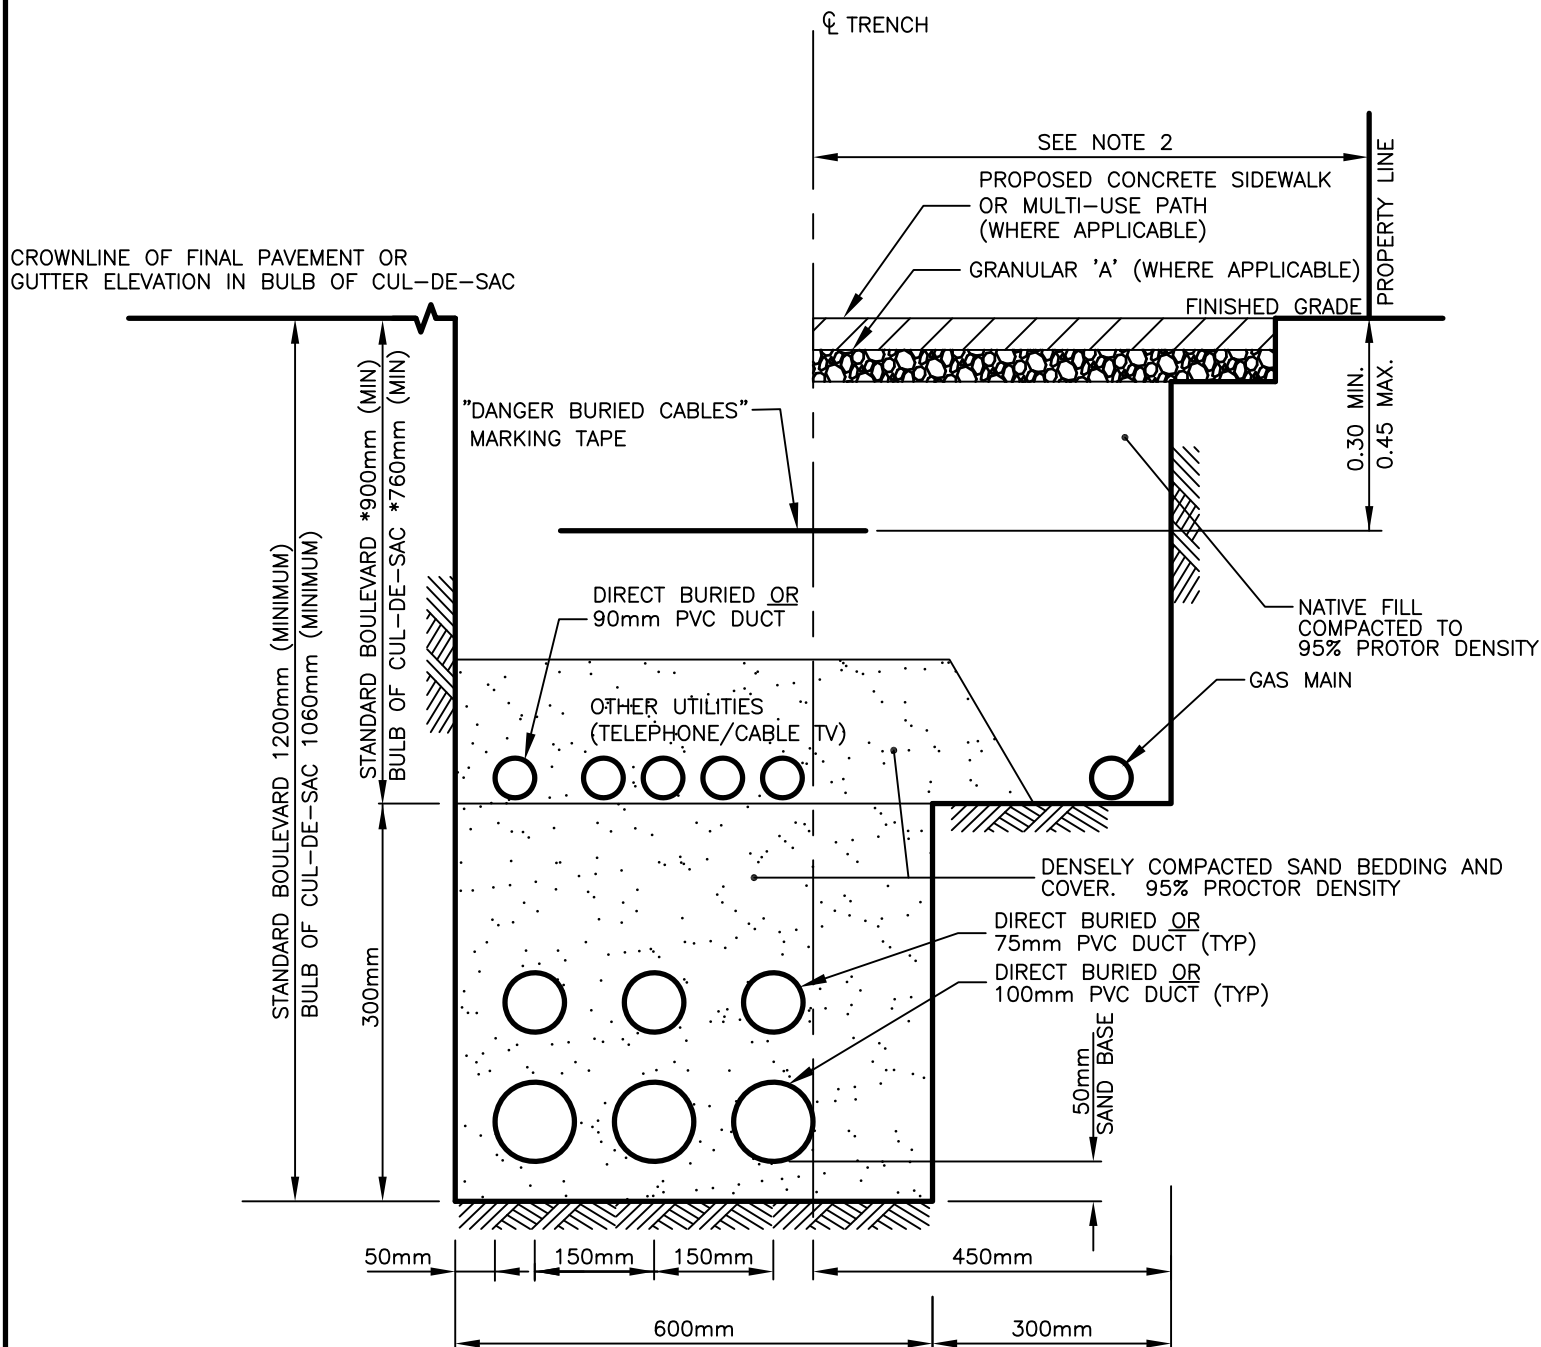

NOTES :

1. 100mm P.V.C. TYPE II DUCT REQUIRED UNDER PAVED AREAS & ALL ROAD CROSSINGS  
CAPACITY PER DUCT: A) 1-PRIMARY CABLE  
B) 2-SECONDARY CABLES
2. TIE TO PROPERTY LINE: REFER TO OS-201 THROUGH OS-208  
-IN BULB PORTION OF A CUL-DE-SAC REFER TO OS-520.  
-OFFSET TO CENTRELINE OF TRENCH IS TO REMAIN PARALLEL TO CURB  
THROUGHOUT THE RADIUS OF THE PAVEMENT ELBOW (OS-511)
3. \* MINIMUM DEPTH FOR A ROAD CROSSING - REFER TO DRAWING OS-221.
4. MEASUREMENTS IN METRES AND/OR MILLIMETRES UNLESS OTHERWISE SHOWN.

CITY OF OSHAWA

CHK'D: *S.S.*  
APP'D: *G.H.*  
DATE: APRIL 2024

COMMON TRENCH DETAIL FOR  
DIRECT BURIED CABLES WITH GAS MAIN

REVISION No. 2  
DATE: APRIL 2024  
OS-226